


Re-Circulation Switch Connection Diagram

ATTENTION

Enclosed is a safety shut-off switch kit for use with the re-circulation system installed on your Leslie Constantemp Heater. This switch adds an additional measure of safety by shutting down the pump in the re-circulation line in the event of an over temperature situation.

This shut-off switch can be installed anywhere in the re-circulation line and should be wired as illustrated below. Please conform to all local and federal codes and guidelines in connecting this switch.

Please contact one of our Leslie Service Centers or the Leslie World Headquarters located in Tampa, Florida for additional information or installation guidelines.

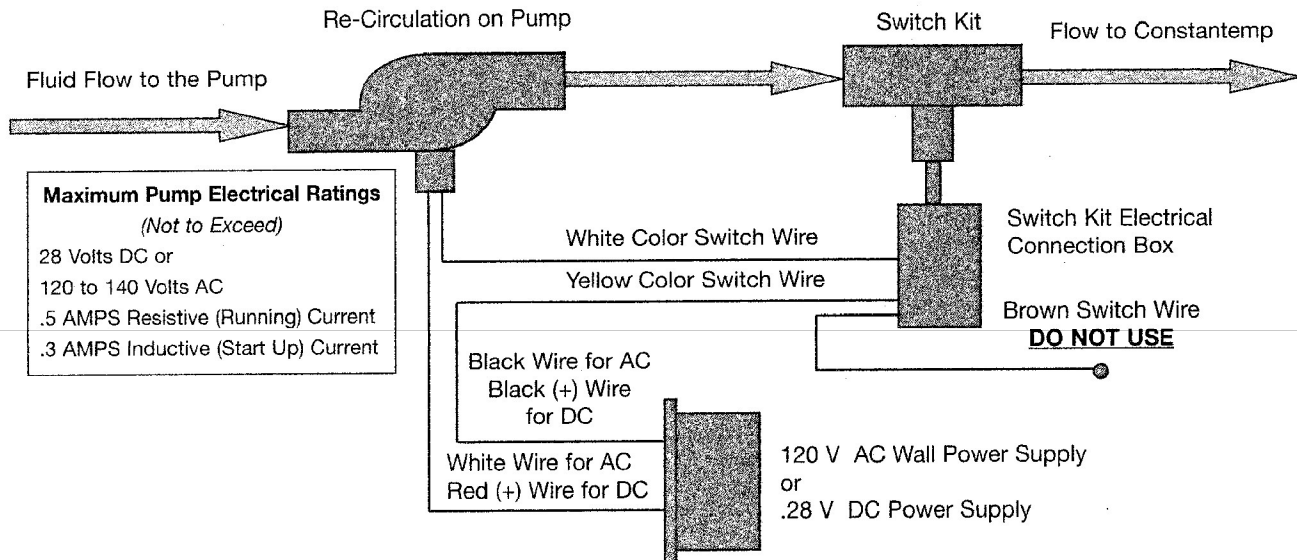

A subsidiary of CIRCOR International, Inc.
12501 Telecom Drive • Tampa, FL 33637-0906

Ph: (813) 978-1000 • Fax: (813) 978-0984
www.lesliecontrols.com

This document was created with Win2PDF available at <http://www.win2pdf.com>.
The unregistered version of Win2PDF is for evaluation or non-commercial use only.
This page will not be added after purchasing Win2PDF.