



PCA Change for FTE14 Series

1. Unassembled the cover of required FTE14 series trap to change the PCA.
2. Remove the old PCA and assemble the new PCA Kit into the cover.
3. Use the following fixture to start the PCA conversion process.

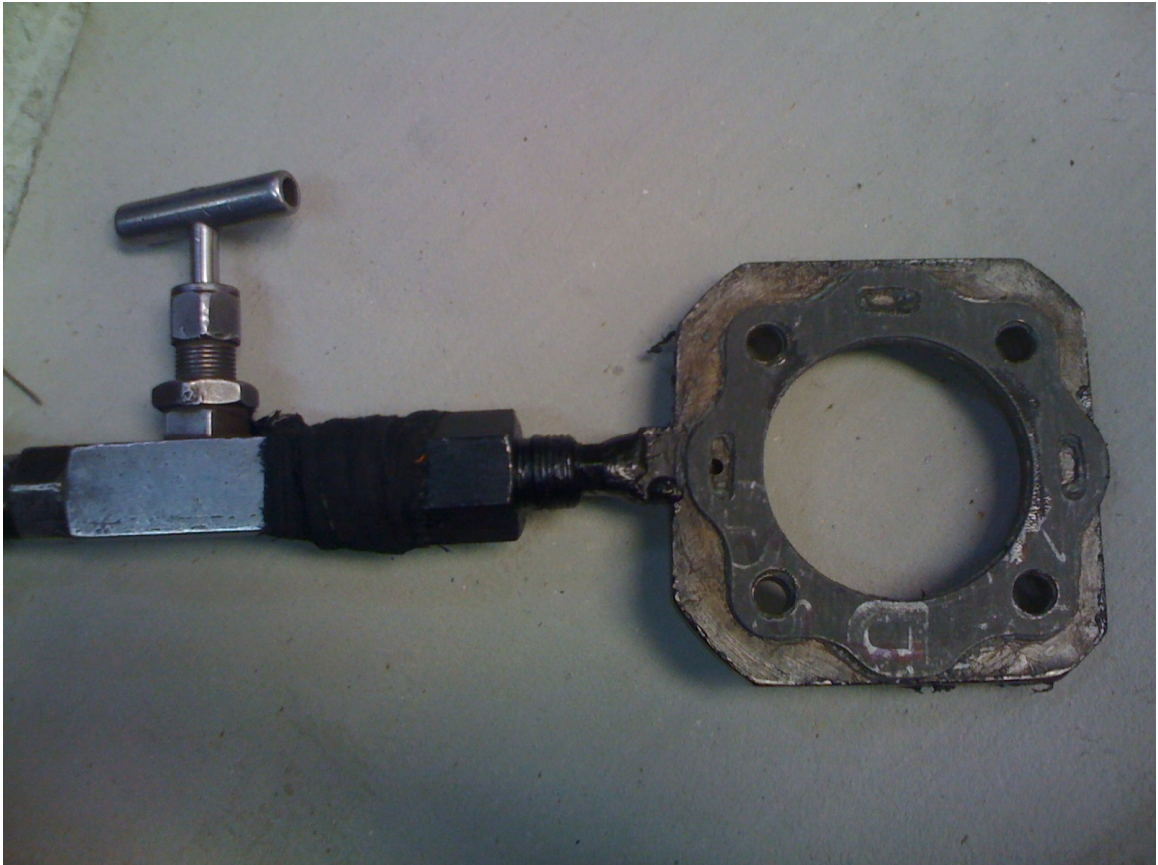


4. Replace Air Vent with 1/4" plug as shown.
5. Place and tighten the cover using standard nuts and bolts as shown below.

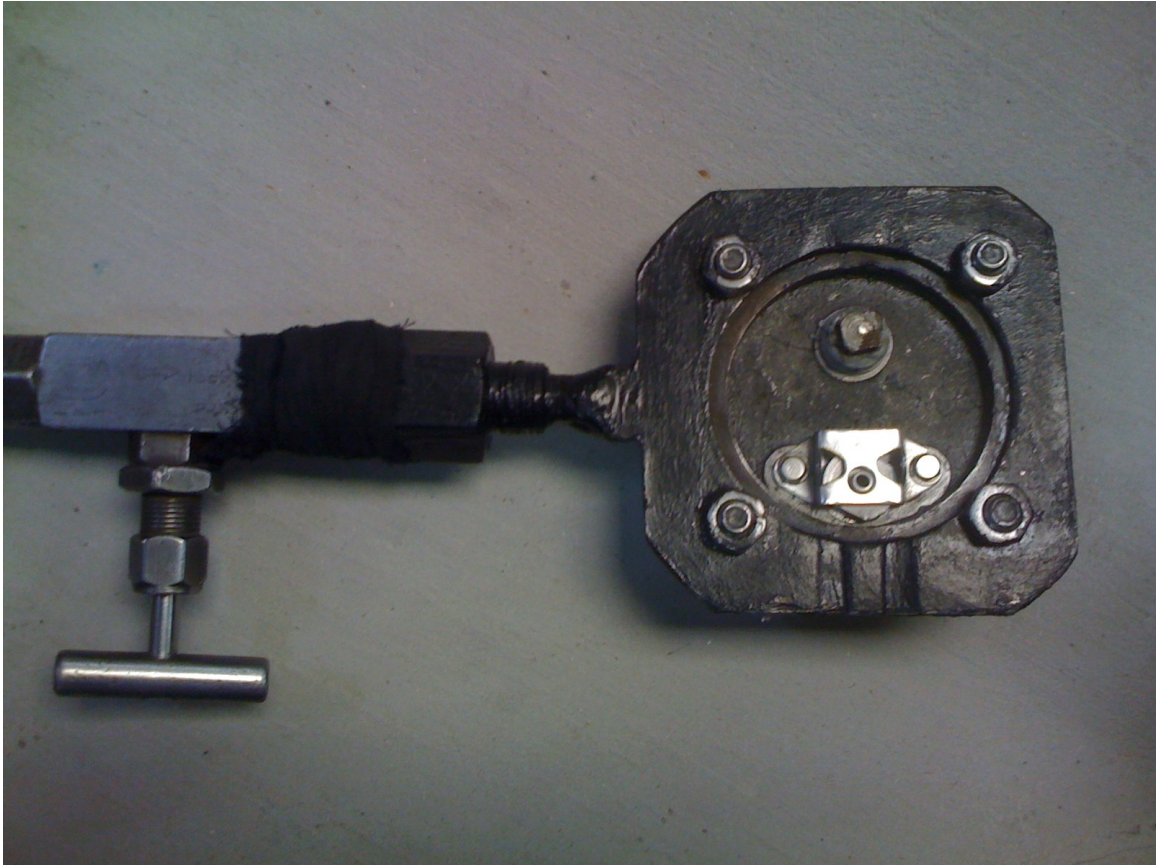

6. Place the float in place using the float pin and start the air supply. The setting air pressure should be much less than the differential pressure in order to prevent float being lift up while setting. Eg. If the Kit is used for 200 PSI then testing Air Pressure should not increase 130 PSI.



7. Once the Air Supply starts use your fingers to check if any Air is leaking between Orifice and Float.

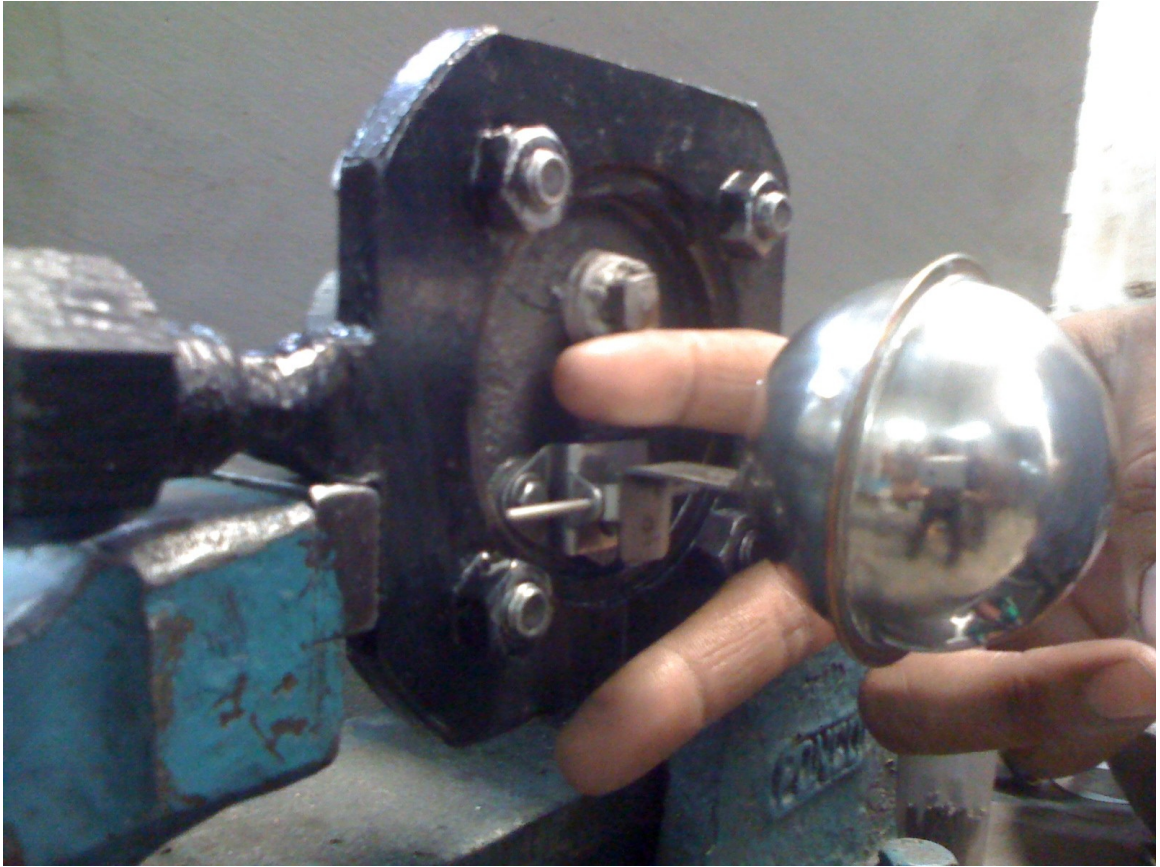

8. If you feel air leakage then adjust the Support frame or float position as shown below.

